


BALLAST

N.B. for 220 V supplies, connect the neutral to Terminal 3; for 200 V supplies, connect the neutral to Terminal 2.

MANDATORY

20 μ F 300 V
Capacitor
(e.g. Philips
L5020/07)

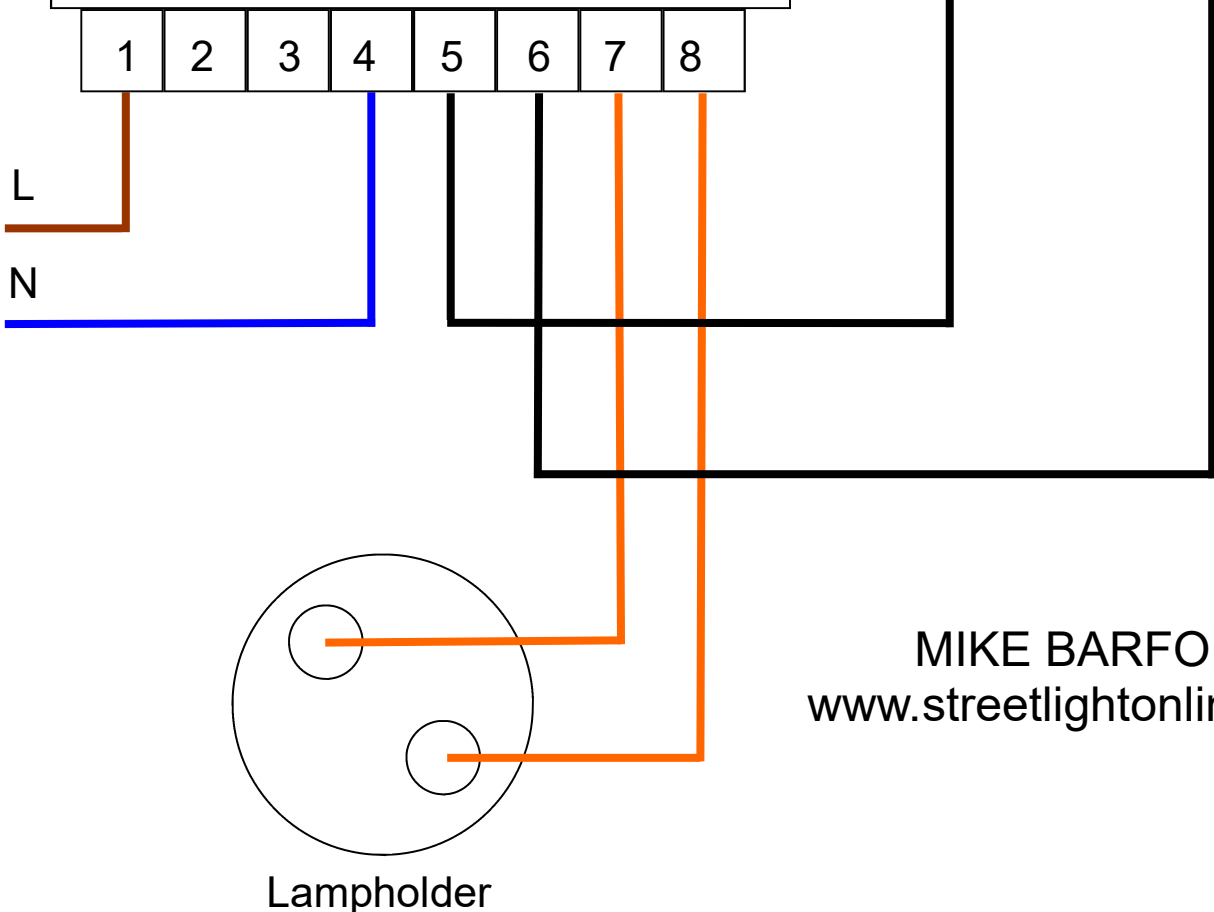

MIKE BARFORD
www.streetlightonline.co.uk